



ANNUAL WATER QUALITY REPORT

WATER TESTING PERFORMED IN 2018

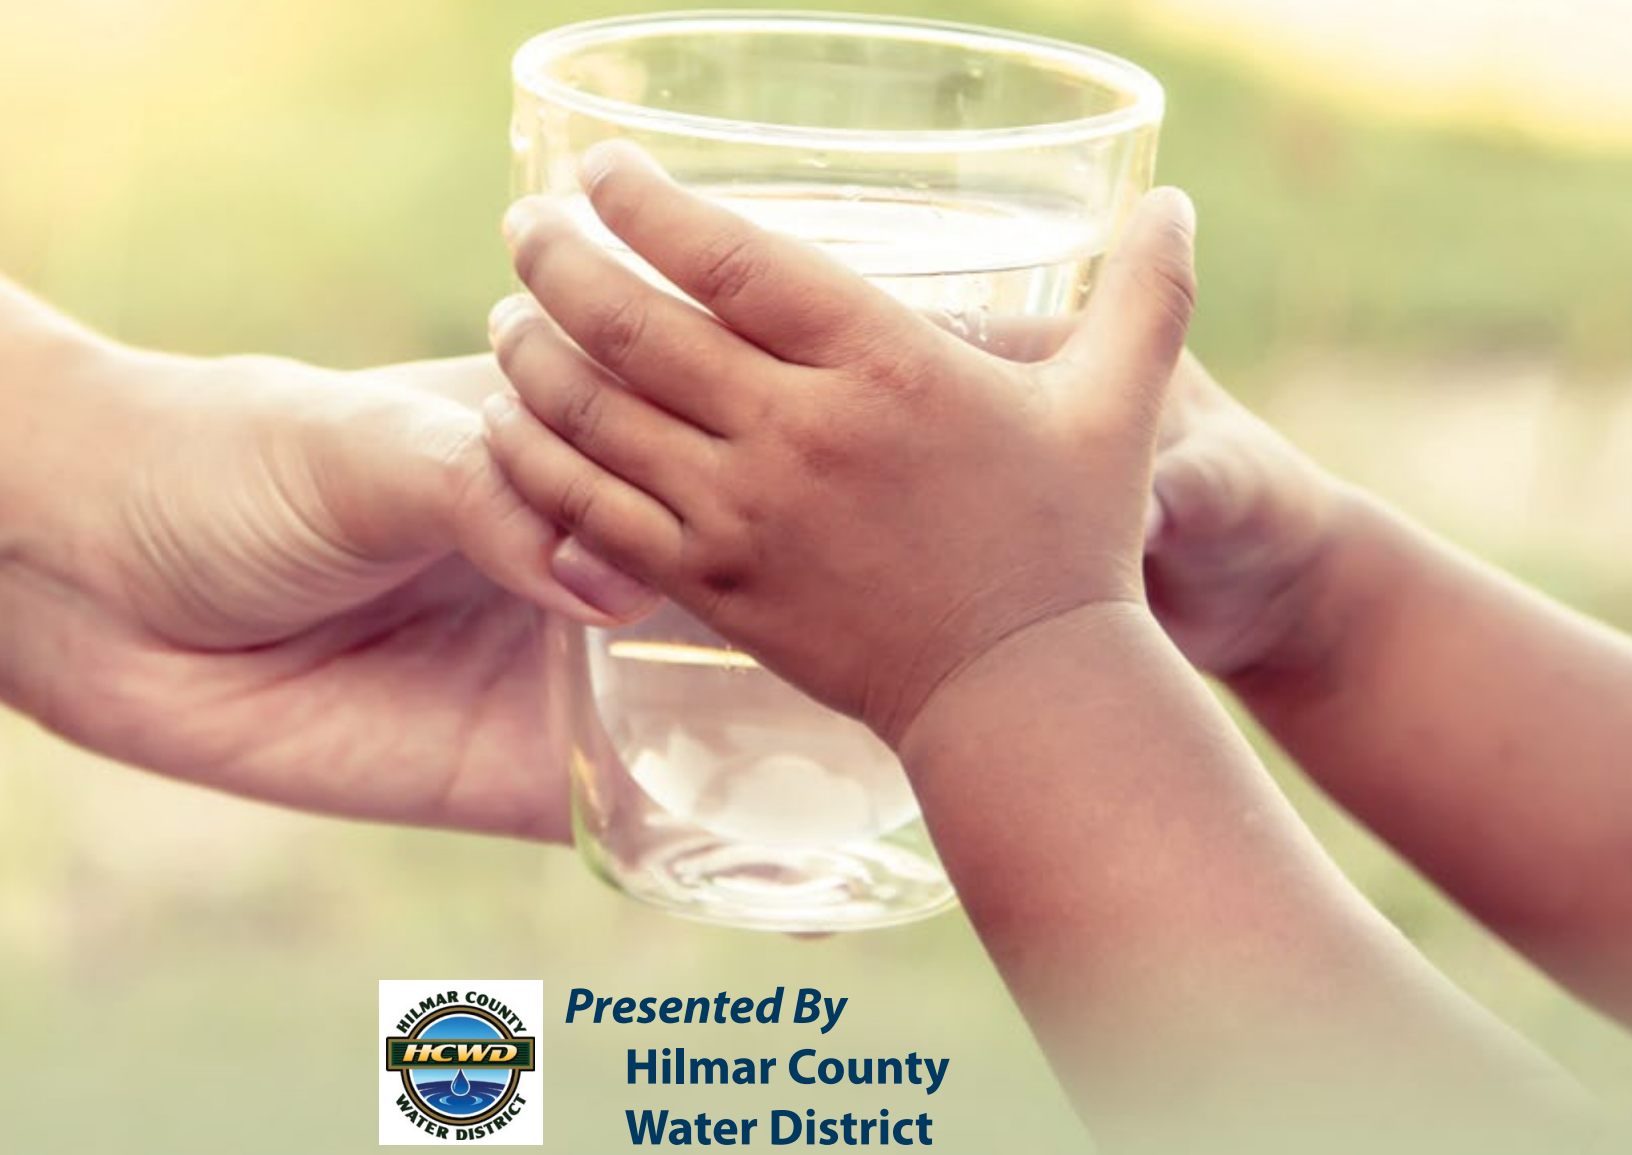

Presented By
**Hilmar County
Water District**

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.

Este relatório contém a informação importante sobre sua água bebendo. Tenha-o por favor traduzido por um amigo ou por alguém que o compreende e o pode o traduzir para você.

Our Mission Continues

We are once again pleased to present our annual water quality report covering all testing performed between January 1 and December 31, 2018. Over the years, we have dedicated ourselves to producing drinking water that meets all state and federal standards. We continually strive to adopt new methods for delivering the best-quality drinking water to you. As new challenges to drinking water safety emerge, we remain vigilant in meeting the goals of source water protection, water conservation, and community education, while continuing to serve the needs of all our water users.

Please remember that we are always available should you ever have any questions or concerns about your water.

Where Does My Water Come From?

Your water comes from two District-owned wells located approximately one mile northeast of town. The newest of these wells, Woody Well #7, has been a huge benefit to our water system. We continue to utilize the Jake Well #6 and hope it will continue to provide good-quality water for a long time to come. Each well averages 330 feet in depth and has a sanitary seal in the first 150 feet of the well column. These wells pump over 310 million gallons of water annually for the District's customers.



Community Participation

You are invited to attend and participate in our public forum and voice your concerns about your drinking water. District Directors meet the first Tuesday of each month at 7 p.m. at the District business office, located at 8319 Lander Avenue, Hilmar, CA 95324. The agendas for meetings are posted at the office and online at www.hilmarcwd.org.



Source Water Assessment

This is an assessment of the delineated area around our listed sources through which contaminants, if present, could migrate and reach our source water. It also includes an inventory of potential sources of contamination within the delineated area, and a determination of the water supply's susceptibility to contamination by the identified potential sources.

According to the Source Water Assessment Plan, our water is considered most vulnerable to the effects of agricultural drainage, grazing, lagoon/liquid wastes, animal operations, and septic systems. A copy of the complete assessment is available for review at the District's office during business hours.

Important Health Information

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants may be particularly at risk from infections. These people should seek advice about drinking water from their health care providers. The U.S. EPA/CDC (Centers for Disease Control and Prevention) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and other microbial contaminants are available from the Safe Drinking Water Hotline at (800) 426-4791 or <http://water.epa.gov/drink/hotline>.



Lead in Home Plumbing

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. We are responsible for providing high-quality drinking water, but we cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. (If you do so, you may wish to collect the flushed water and reuse it for another beneficial purpose, such as watering plants.) If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at (800) 426-4791 or at www.epa.gov/safewater/lead.

Substances That Could Be in Water

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity.

In order to ensure that tap water is safe to drink, the U.S. Environmental Protection Agency (U.S. EPA) and the State Water Resources Control Board (State Board) prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The U.S. Food and Drug Administration regulations and California law also establish limits for contaminants in bottled water that provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk.

Contaminants that may be present in source water include:

Microbial Contaminants, such as viruses and bacteria, that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife;

Inorganic Contaminants, such as salts and metals, that can be naturally occurring or can result from urban storm-water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming;

Pesticides and Herbicides, that may come from a variety of sources such as agriculture, urban storm-water runoff, and residential uses;

Organic Chemical Contaminants, including synthetic and volatile organic chemicals, which are by-products of industrial processes and petroleum production, and which can also come from gas stations, urban storm-water runoff, agricultural applications, and septic systems;

Radioactive Contaminants, that can be naturally occurring or can be the result of oil and gas production and mining activities.

More information about contaminants and potential health effects can be obtained by calling the U.S. EPA's Safe Drinking Water Hotline at (800) 426-4791.

About our Violation

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not your drinking water meets health standards. During the third quarter of 2018, we did not monitor for 1,2,3,-trichloropropane (1,2,3-TCP) from Wells 6 and 7, and therefore, cannot be sure of the quality of your drinking water during that time.

Upon being notified of this violation, we immediately analyzed our water supply for 1,2,3-TCP. Results of the analysis have been received and properly recorded as required by state and federal laws. We do not believe that missing this monitoring requirement had any impact on public health and safety. We have already taken the steps to ensure that adequate monitoring and reporting will be performed in the future so that this oversight will not be repeated.

Protecting Your Water

Bacteria are a natural and important part of our world. There are around 40 trillion bacteria living in each of us; without them, we would not be able to live healthy lives. Coliform bacteria are common in the environment and are generally not harmful themselves. The presence of this bacterial form in drinking water is a concern, however, because it indicates that the water may be contaminated with other organisms that can cause disease.

In 2016, the U.S. EPA passed a new regulation called the Revised Total Coliform Rule, which requires additional steps that water systems must take in order to ensure the integrity of the drinking water distribution system by monitoring for the presence of bacteria like total coliform and *E. coli*. The rule requires more stringent standards than the previous regulation, and it requires water systems that may be vulnerable to contamination to have in place procedures that will minimize the incidence of contamination. Water systems that exceed a specified frequency of total coliform occurrences are required to conduct an assessment of their system and correct any problems quickly. The U.S. EPA anticipates greater public health protection

under the new regulation due to its more preventive approach to identifying and fixing problems that may affect public health.

Though we have been fortunate to have the highest-quality drinking water, our goal is to eliminate all potential pathways of contamination into our distribution system, and this new rule helps us to accomplish that goal.



QUESTIONS?

For more information about this report, or for any questions relating to your drinking water, please contact Curtis Jorritsma at (209) 632-3522.

To The Last Drop

The National Oceanic and Atmospheric Administration (NOAA) defines drought as a deficiency in precipitation over an extended period of time, usually a season or more, resulting in a water shortage causing adverse impacts on vegetation, animals, and/or people. Drought strikes in virtually all climate zones, from very wet to very dry.

There are primarily three types of drought: Meteorological Drought, which refers to the lack of precipitation, or the degree of dryness and the duration of the dry period; Agricultural Drought, which refers to the agricultural impact of drought, focusing on precipitation shortages, soil water deficits, and reduced ground water or reservoir levels needed for irrigation; and Hydrological Drought, which pertains to drought that usually occurs following periods of extended precipitation shortfalls that can impact water supply (i.e., stream flow, reservoir and lake levels, ground water).

Drought is a temporary aberration from normal climatic conditions, thus it can vary significantly from one region to another. Although normally occurring, human factors, such as water demand, can exacerbate the duration and impact that drought has on a region. By following simple water conservation measures, you can help significantly reduce the lasting effects of extended drought.



BY THE NUMBERS

The number of Olympic-sized swimming pools it would take to fill up all of Earth's water.

800
TRILLION

1
CENT

The average cost for about 5 gallons of water supplied to a home in the U.S.

The amount of Earth's water that is salty or otherwise undrinkable, or locked away and unavailable in ice caps and glaciers.

99%

50
GALLONS

The average daily number of gallons of total home water use for each person in the U.S.

The amount of Earth's surface that's covered by water.

71%

330
MILLION

The amount of water on Earth in cubic miles.

The amount of Earth's water that is available for all of humanity's needs.

1%

Table Talk

Get the most out of the Testing Results data table with this simple suggestion. In less than a minute, you will know all there is to know about your water:

For each substance listed, compare the value in the Amount Detected column against the value in the MCL (or AL, SMCL) column. If the Amount Detected value is smaller, your water meets the health and safety standards set for the substance.

Other Table Information Worth Noting

Verify that there were no violations of the state and/or federal standards in the Violation column. If there was a violation, you will see a detailed description of the event in this report.

If there is an ND or a less-than symbol (<), that means that the substance was not detected (i.e., below the detectable limits of the testing equipment).

The Range column displays the lowest and highest sample readings. If there is an NA showing, that means only a single sample was taken to test for the substance (assuming there is a reported value in the Amount Detected column).

If there is sufficient evidence to indicate from where the substance originates, it will be listed under Typical Source.

Test Results

Our water is monitored for many different kinds of substances on a very strict sampling schedule. And, the water we deliver must meet specific health standards. Here, we only show those substances that were detected in our water (a complete list of all our analytical results is available upon request). Remember that detecting a substance does not mean the water is unsafe to drink; our goal is to keep all detects below their respective maximum allowed levels.

The State recommends monitoring for certain substances less than once per year because the concentrations of these substances do not change frequently. In these cases, the most recent sample data are included, along with the year in which the sample was taken.

Hilmar County Water District routinely collects water samples for bacteria testing and in 2018 all tests came back negative.

REGULATED SUBSTANCES

| SUBSTANCE (UNIT OF MEASURE) | YEAR SAMPLED | MCL [MRDL] | PHG (MCLG) [MRDLG] | AMOUNT DETECTED | RANGE LOW-HIGH | VIOLATION | TYPICAL SOURCE |
|--|-----------------|-----------------------------|---------------------------|--------------------|-------------------|-----------|---|
| 1,2,3-Trichloropropane [1,2,3-TCP] (ppt) | 2018 | 5 | 0.7 | ND ¹ | NA | No | Discharge from industrial and agricultural chemical factories; leaching from hazardous waste sites; cleaning and maintenance solvent, paint and varnish remover, and degreasing agent; by-product from production of other compounds and pesticides |
| Arsenic (ppb) | 2018 | 10 | 0.004 | 4.50 | 4.1–5.83 | No | Erosion of natural deposits; runoff from orchards; glass and electronics production wastes |
| Chlorine (ppm) | 2018 | [4.0 (as Cl ₂)] | [4 (as Cl ₂)] | 0.69 | 0.36–1.01 | No | Drinking water disinfectant added for treatment |

Tap Water Samples Collected for Copper and Lead Analyses from Sample Sites throughout the Community

| SUBSTANCE (UNIT OF MEASURE) | YEAR SAMPLED | AL | PHG (MCLG) | AMOUNT DETECTED (90TH %ILE) | SITES ABOVE AL/TOTAL SITES | VIOLATION | TYPICAL SOURCE |
|--------------------------------|-----------------|-----|---------------|-----------------------------------|----------------------------------|-----------|---|
| Copper (ppm) | 2016 | 1.3 | 0.3 | 0.169 | 0/20 | No | Internal corrosion of household plumbing systems; erosion of natural deposits; leaching from wood preservatives |
| Lead (ppb) | 2016 | 15 | 0.2 | 2.3 | 1/20 | No | Internal corrosion of household water plumbing systems; discharges from industrial manufacturers; erosion of natural deposits |

¹ND = Not detected in any sample.

Definitions

90th %ile: The levels reported for lead and copper represent the 90th percentile of the total number of sites tested. The 90th percentile is equal to or greater than 90% of our lead and copper detections.

AL (Regulatory Action Level): The concentration of a contaminant which, if exceeded, triggers treatment or other requirements that a water system must follow.

MCL (Maximum Contaminant Level): The highest level of a contaminant that is allowed in drinking water. Primary MCLs are set as close to the PHGs (or MCLGs) as is economically and technologically feasible. Secondary MCLs (SMCLs) are set to protect the odor, taste, and appearance of drinking water.

MCLG (Maximum Contaminant Level Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs are set by the U.S. EPA.

MRDL (Maximum Residual Disinfectant Level): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

MRDLG (Maximum Residual Disinfectant Level Goal): The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.

NA: Not applicable.

ND (Not detected): Indicates that the substance was not found by laboratory analysis.

NS: No standard.

PDWS (Primary Drinking Water Standard): MCLs and MRDLs for contaminants that affect health along with their monitoring and reporting requirements, and water treatment requirements.

PHG (Public Health Goal): The level of a contaminant in drinking water below which there is no known or expected risk to health. PHGs are set by the California EPA.

ppb (parts per billion): One part substance per billion parts water (or micrograms per liter).

ppm (parts per million): One part substance per million parts water (or milligrams per liter).

ppt (parts per trillion): One part substance per trillion parts water (or nanograms per liter).